



COMPASS

Heated diode technology in an ergonomic, accurate leak detector.



- Patented heated diode
- Sensitive for all CFC, HCFC and HFC
- Sensitivity: 1 à 2 g/yr according to EN 14624 (F-Gas)
- Auto zeroing
- Rechargeable NiMH-power stick (5,5 hours of operating)
- Water-resistant filter protecting the sensor
- Hi/Lo sensitivity selector
- Easy one-button operation, ergonomic design
- Warning low battery
- Headphone jack
- Ability to run on AC power

SPECIFICATIONS

Minimum sensitivity to R12, R134a, R404A	1-2g/yr according to EN 14624
Control	Power: on/off Sensitivity: High/Low
Calibration / Zero setting	Automatic
Weight with battery	0,52 kg
Power source	NiMH-battery, AC adapter
Battery life	5,5 hours
Charging options	220V AC adapter, 1,8m cord 12 V adapter with cigarette lighter plug
Probe	Rubber-coated flexible metal, approx. 43 cm
Charger	Build in
Certifications	CE Marking Power Safety and EMC. SAE J1627
Warranty	2 years

ACCESSORIES

717-202-G6	Standard 220 Volt-Model
032-404	Headphones
703-080-G10	TEK-Check R-134a reference leak
Replacement parts:	
033-0020	220V adapter and 1,8m cord
703-055-P1	12V power cord with cigarette lighter plug
712-700-G1	NiMH-battery
703-020-G1	Heated diode sensor
705-600-G1	Filters
717-700-G1	Carrying case, hard plastic


- Delivered in a hard storage case including; Compass, heated diode, NiMH power stick, 12V and 230V adapter, filters, operating manual and Verification Journal®.

INFICON Sensor Technology



IR-Sensor


Infrared absorption technologie

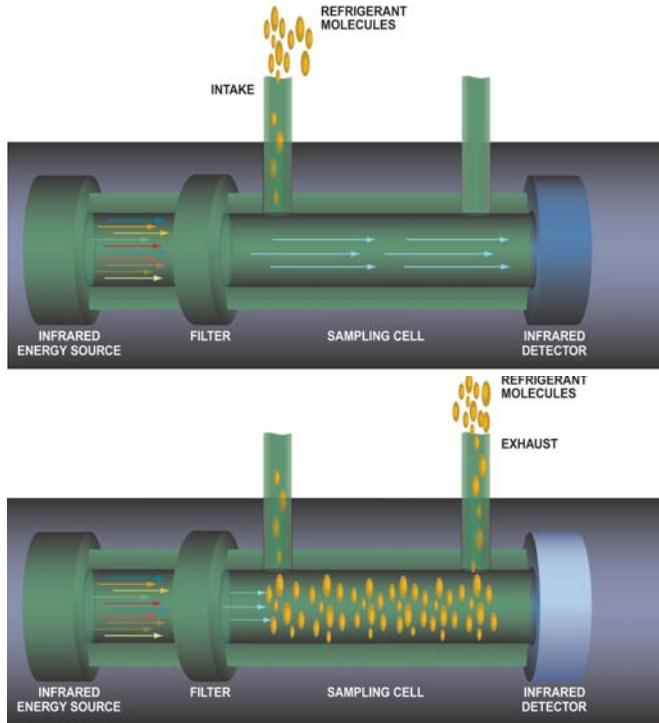

- The INFICON D-TEK Select and D-TEK CO2 use an Infrared absorption filtermeter consisting of a sampling cell with an infrared source at one end, an infrared energy detector at the other end, and an optical filter in between them.
- Like the visible light we see, refrigerants have an absorption spectra for electromagnetic infrared energy. This spectra is in the range of 7.5 - 14 micrometers.
- The infrared source creates a high-intensity stream of energy incorporating all wavelengths of infrared energy; this is filtered by the optical filter.
- The optical filter blocks all wavelengths except those that refrigerant absorb.
- The filtered infrared energy strikes the detector and causes it to warm up.
- When refrigerant is drawn through the sampling cell by the internal pump, some of the infrared energy is absorbed by the refrigerant.
- This causes a decrease of the amount of energy reaching the detector and a corresponding drop in the detector's temperature which triggers the D-TEK Select and D-TEK CO2 to alarm.
- Digital IC gives reaction- and recovery times in fractions of a second.
- Extremely high selectivity because of optical filter.
- The sensor will not be harmed by high refrigerant doses nor degrade over time.
- Immediate recovery time after the refrigerant clears the cell.

Heated-diode® Sensor

Elektrochemische technologie

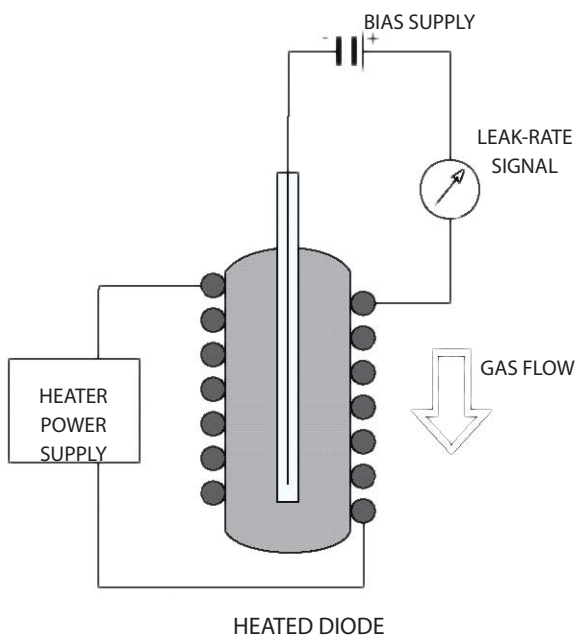

- Patented heated diode sensor offers outstanding sensitivity.
- Resists dirt, water, oil, and other contaminants.
- The INFICON TEK-Mate and Compass Refrigerant Leak Detector incorporate a electrochemical sensor consisting of a ceramic substrate, doped with a reactive element, and maintained at high temperature by a built-in heating element.
- When a halogen-bearing gas contacts with the hot surface, chlorine, bromine or fluorine atoms are separated from the molecule and ionized. This causes an electrical current to flow within the ceramic to a collection electrode at the center.
- Provides similar response to all CFCs, HCFCs en HFCs.